


- 1 SEE CODE PLAN FOR REQUIRED PARTITION FIRE RATINGS
- 2 NOT USED
- 3 WHEN PARTITION FRAMING RUNS HIGHER THAN 12'-0" AFF. BRACE PTN BACK TO STRUCTURE ABOVE WITH METAL STUDS EVERY 4'-0" OC MINIMUM
- 4 PROVIDE 1/2" DEFLECTION SPACE AT THE TOP OF STUDS AT ALL PARTITIONS EXTENDING TO STRUCTURE, UNLESS NOTED OTHERWISE
- 5 GENERAL CONTRACTOR SHALL PROVIDE AND COORDINATE ALL IN WALL BLOCKING FOR WALL MOUNTED CASEWORK AND EQUIPMENT SUPPLIED BY THIS CONTRACT. OWNER FURNISHED OR BY VENDORS. CONTRACTORS OPTION TO PROVIDE 3/4" FRT PLYWOOD (PRESERVATIVE TREATED ON EXTERIOR WALLS) OR SHEET METAL BLOCKING FOR WALL MOUNTED EQUIPMENT, CASEWORK, DOOR STOPS, ACCESSORIES ETC, UNLESS NOTED OTHERWISE
- 6 THE DIMENSION SHOWING THE LOCATION OF A DOOR FRAME IN GPBD WALLS IS TO THE INSIDE OF THE DOOR FRAME (DOOR OPENING). PROVIDE 4" TYPICAL DIMENSION IF NO DIMENSION IS SHOWN
- 7 IN WET AREAS SUCH AS SHOWER, TUB, GLASS WASHING ROOMS, SOILED UTILITY ROOMS, JANITOR CLOSETS, COMMERCIAL FOOD PROCESSING ROOMS ETC, USE TILE BACKER BOARD BEHIND THE CT AND EXTEND TO 24" BEYOND ALL SIDES OF THE PLUMBING FIXTURE. IN DOUBLE LAYER WALLS WHERE THE TILE BACKER BOARD IS INSTALLED OVER A BASE LAYER OF GPBD, APPLY A WATER BARRIER (BUILDING WRAP) NOT A VAPOR RETARDER, OVER THE BASE LAYER OF GPBD. IN HIGH HUMIDITY AREAS SUCH AS SAUNAS, STEAM ROOMS AND SWIMMING POOLS, WHERE WALLS ARE EXPOSED TO CONSTANT MOISTURE. USE TILE BACKER BOARD BEHIND CT
- 8 IN WET AREAS SUCH AS SOILED UTILITY ROOMS, JANITOR CLOSETS ETC, USE 5/8" WATER RESISTANT GPBD OR 5/8" FR WATER RESISTANT GPBD. EXCEPTION: DO NOT USE WATER RESISTANT GPBD AT CEILINGS OR OVER A VAPOR RETARDER, SEE TILE BACKER BOARD NOTE
- 9 GPBD AND METAL STUDS USED IN FIRE RATED SEPARATION PARTITIONS SHALL EXTEND FROM FLOOR TO UNDERSIDE OF STRUCTURE, UNLESS NOTED OTHERWISE
- 10 CONTRACTORS TO VERIFY CONDITIONS ABOVE CEILING AT EXISTING PARTITIONS WITH FIRE/SMOKE PARTITION SYMBOLS. REPAIR CONDITIONS THAT DO NOT MEET REQUIREMENTS OF THE INDICATED FIRE/SMOKE RATING SHOWN, SUCH AS OPENINGS IN PARTITIONS, GAPS AROUND DUCT WORK, PIPES AND CONDUIT, MISSING SMOKE DAMPERS ETC
- 11 WHEN GPBD PARTITIONS ARE LOCATED BELOW STRUCTURE THAT HAS A VERTICAL DEFLECTION MOVEMENT MORE THAN 1/2", PROVIDE PARTITION HEADS WITH VERTICAL MOVEMENT CAPABILITY TO MATCH THAT DEGREE OF MOVEMENT. MAINTAIN THE REQUIRED FIRE RATING OF FIRE RATED PARTITIONS FROM FLOOR TO STRUCTURE ABOVE WITH FIRE TESTED HEAD CONSTRUCTION
- 12 WHERE SMOKE PARTITIONS ARE REQUIRED BY CODE PLANS, THE FOLLOWING APPLIES TO ALL NON-ACOUSTICAL TYPE SMOKE PARTITIONS. EXTEND GPBD ON CORRIDOR SIDE TO STRUCTURE ABOVE, SEAL TOP AND BOTTOM OF PARTITION AND ALL PENETRATIONS THROUGH PARTITION ON CORRIDOR SIDE WITH A SMOKE SEALANT HAVING A MINIMUM WARM SMOKE TEMPERATURE RATING OF 400 DEGREES F. ALL SEALS MUST HAVE PRE-APPROVAL OF CODE OFFICIAL. ROOM SIDE GPBD CAN EXTEND TO 6" ABOVE FINISHED CEILING
- 13 WHERE SMOKE PARTITIONS ARE REQUIRED BY CODE PLANS, THE FOLLOWING APPLIES TO ALL ACOUSTICAL TYPE SMOKE PARTITIONS. EXTEND GPBD ON CORRIDOR SIDE TO STRUCTURE ABOVE, SEAL TOP AND BOTTOM OF PARTITION AND ALL PENETRATIONS THROUGH PARTITION ON CORRIDOR SIDE WITH A SMOKE SEALANT HAVING A MINIMUM WARM SMOKE TEMPERATURE RATING OF 400 DEGREES F. PROVIDE REQUIRED ACOUSTIC SEALANT ON ROOM SIDE AT TOP AND BOTTOM OF PARTITION AND ALL PENETRATIONS THROUGH PARTITION. ALL SEALS MUST HAVE PRE-APPROVAL OF CODE OFFICIAL
- 14 ALL WALLS TO DECK/STRUCTURE ABOVE, UNLESS NOTED OTHERWISE
- 15 LOW WALL FURRING TO EXTEND TO 36" ABOVE FINISHED FLOOR ALONG WEST AND NORTH WALLS WHERE SHOWN. FURRING ALONG EAST WALL VARIES, SEE FLOOR PLAN
- 16 FURRING TO EXTEND TO DECK/STRUCTURE ABOVE AT FULL HEIGHT CASEWORK LOCATIONS, SEE FLOOR PLAN

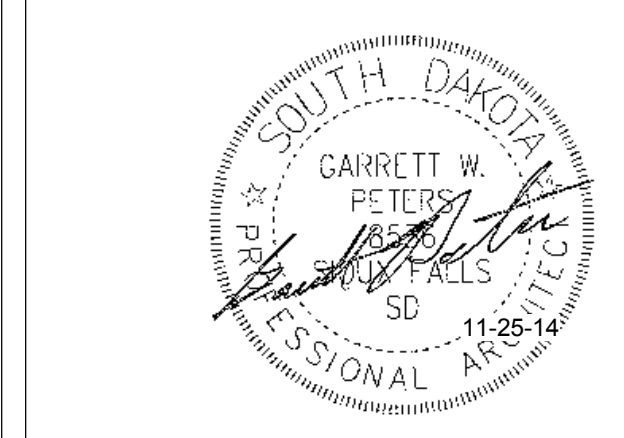

#	Description	Date
1	100% Construction Documents	6-09-14
2	Scope change Review Set	10-02-14
3	Scope change 100% CDs	11-25-14

**AVERA  
SACRED HEART  
5TH FLOOR**

Date: 12/3/2014 7:33:07 AM

## A101

Scale: As indicated